


Fire Alarm & Fire Sprinkler Monitoring Flow Chart

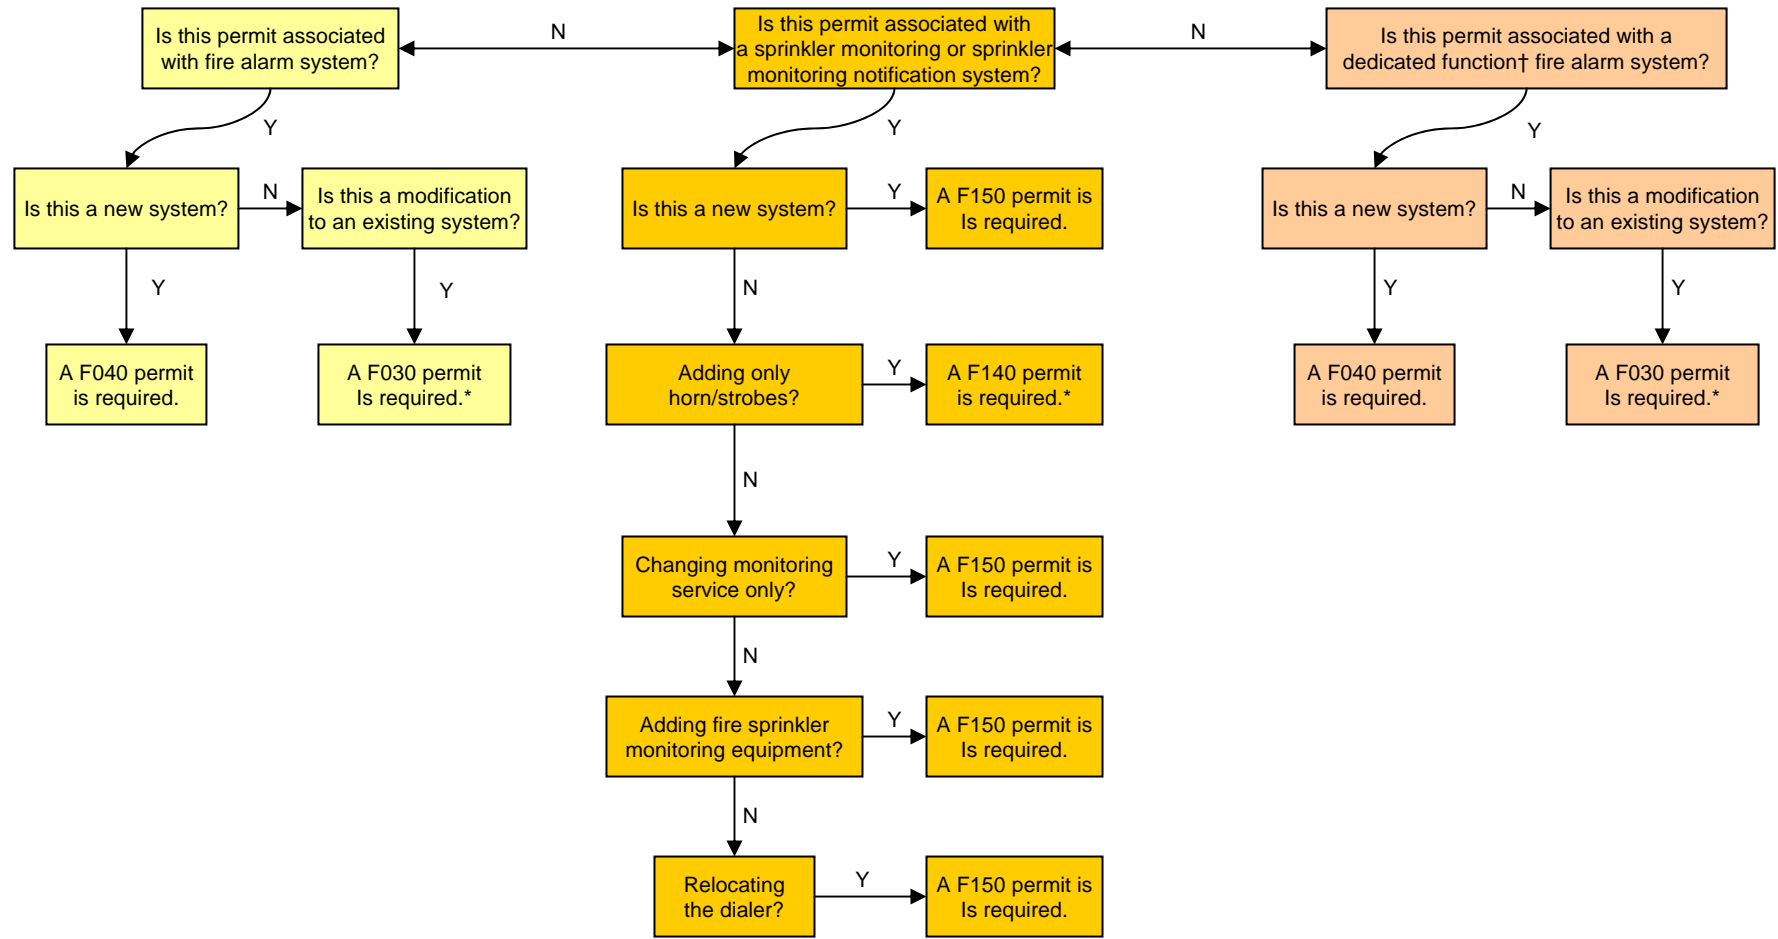

Notes:

* Fees are not required for permits where only 1-4 devices are involved. A device is an initiating device (smoke, heat, duct smoke, flame, pull station, etc.) or a notification appliance (horn, strobe, horn/strobe, speaker, speaker/strobe, etc.) but does not include a control panel, booster, power supply, transponder, transmitter, dialer, annunciator or similar panel.

† A dedicated function fire alarm system is a system which is intended to provide operation of a specifically identified fire safety function, such as elevator recall control